

Caribbean Renewable Energy Forum

T. Bruce Tsuchida

Aruba
October 9-11, 2013





THE **Brattle** GROUP


Dispatch and Curtailment – No Storage

Early-morning curtailments: low load and inflexible generation

Mid-day curtailments

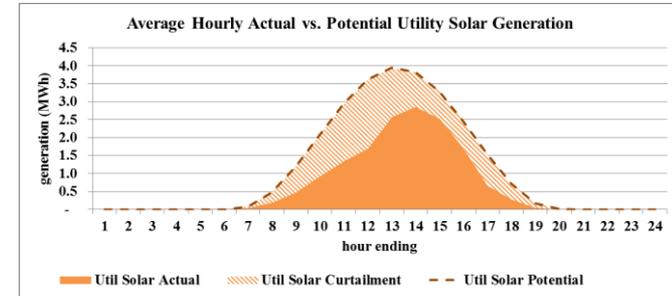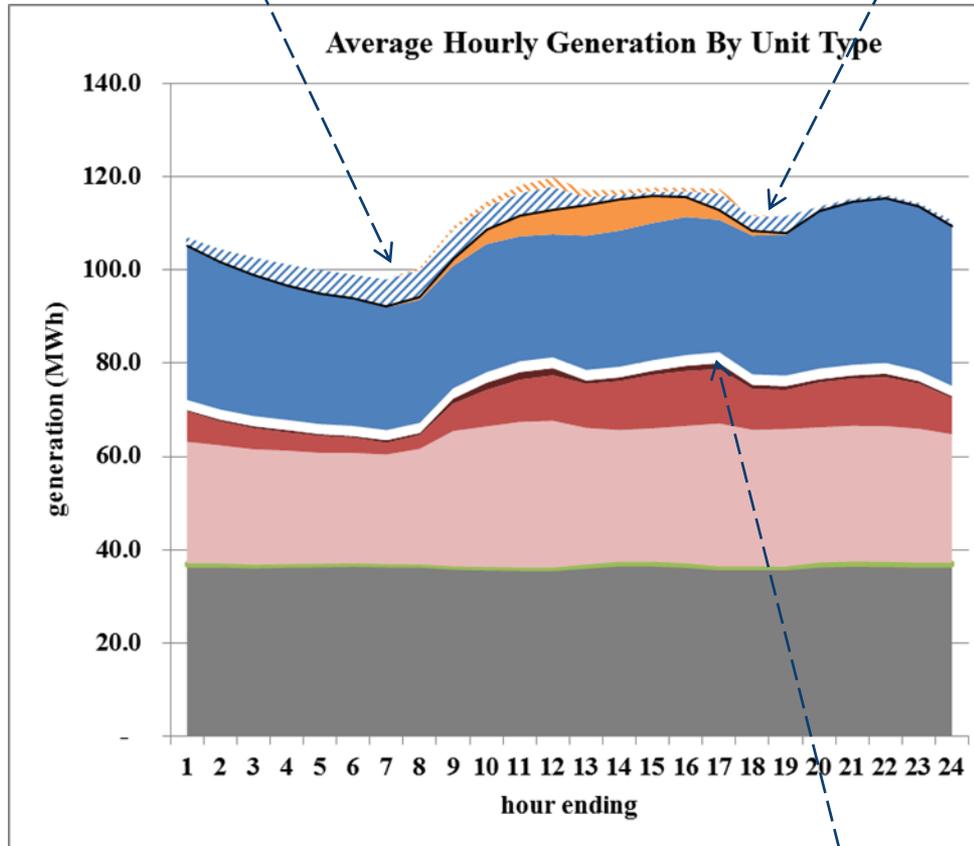

Solar curtailment

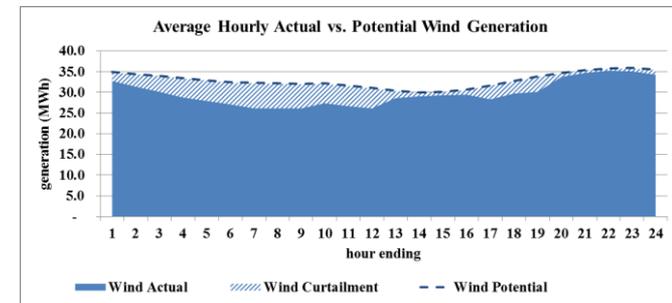



Wind curtailment

Expensive and flexible unit running to provide reserves


Dispatch and Curtailment – With Storage

Very low early-morning curtailments

Minimal mid-day curtailments

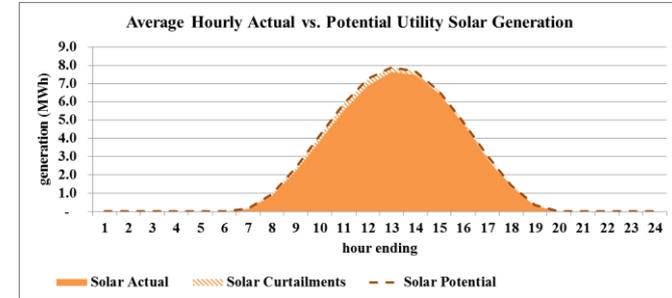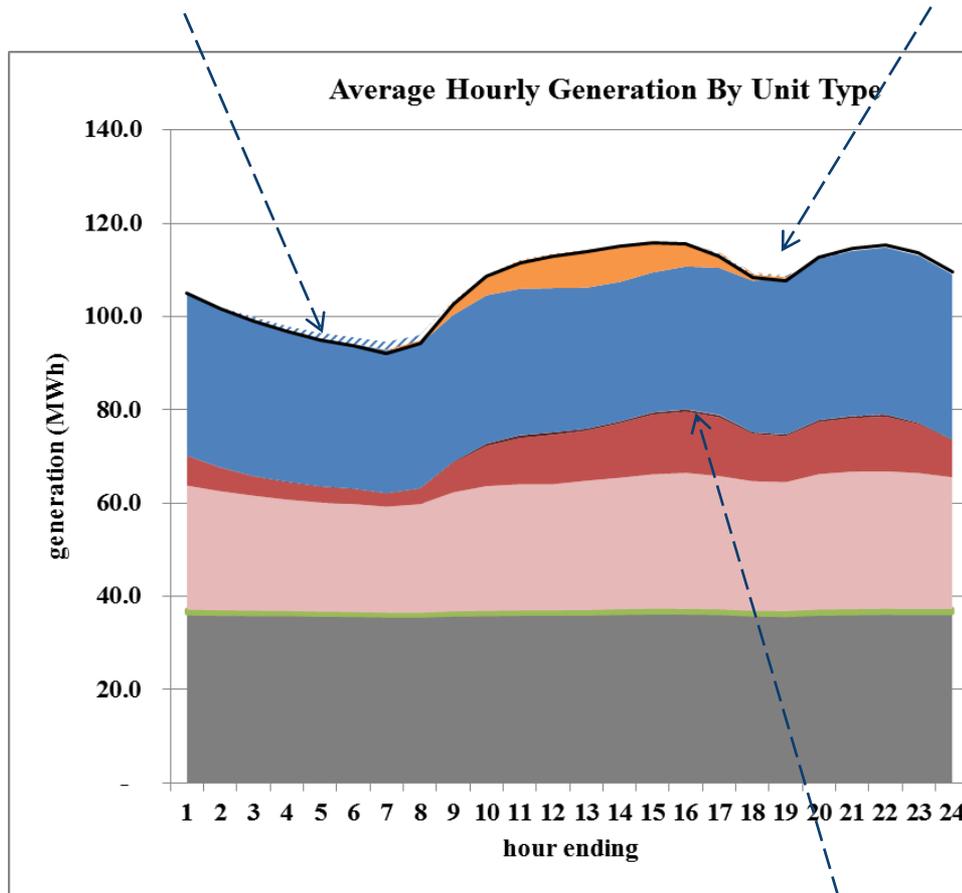

Solar curtailment

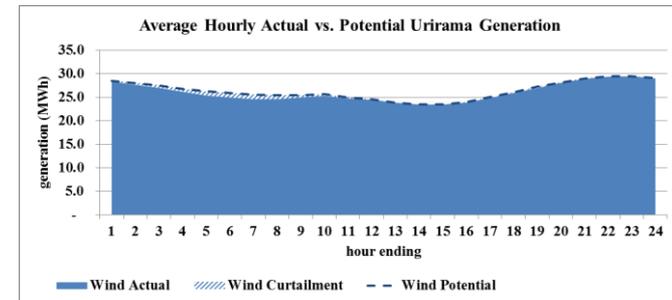

Wind curtailment

Expensive and flexible unit is no longer running